



# Exi -Terminal TERMEX 220/230/320/330

Ex- Zone 1 and 2

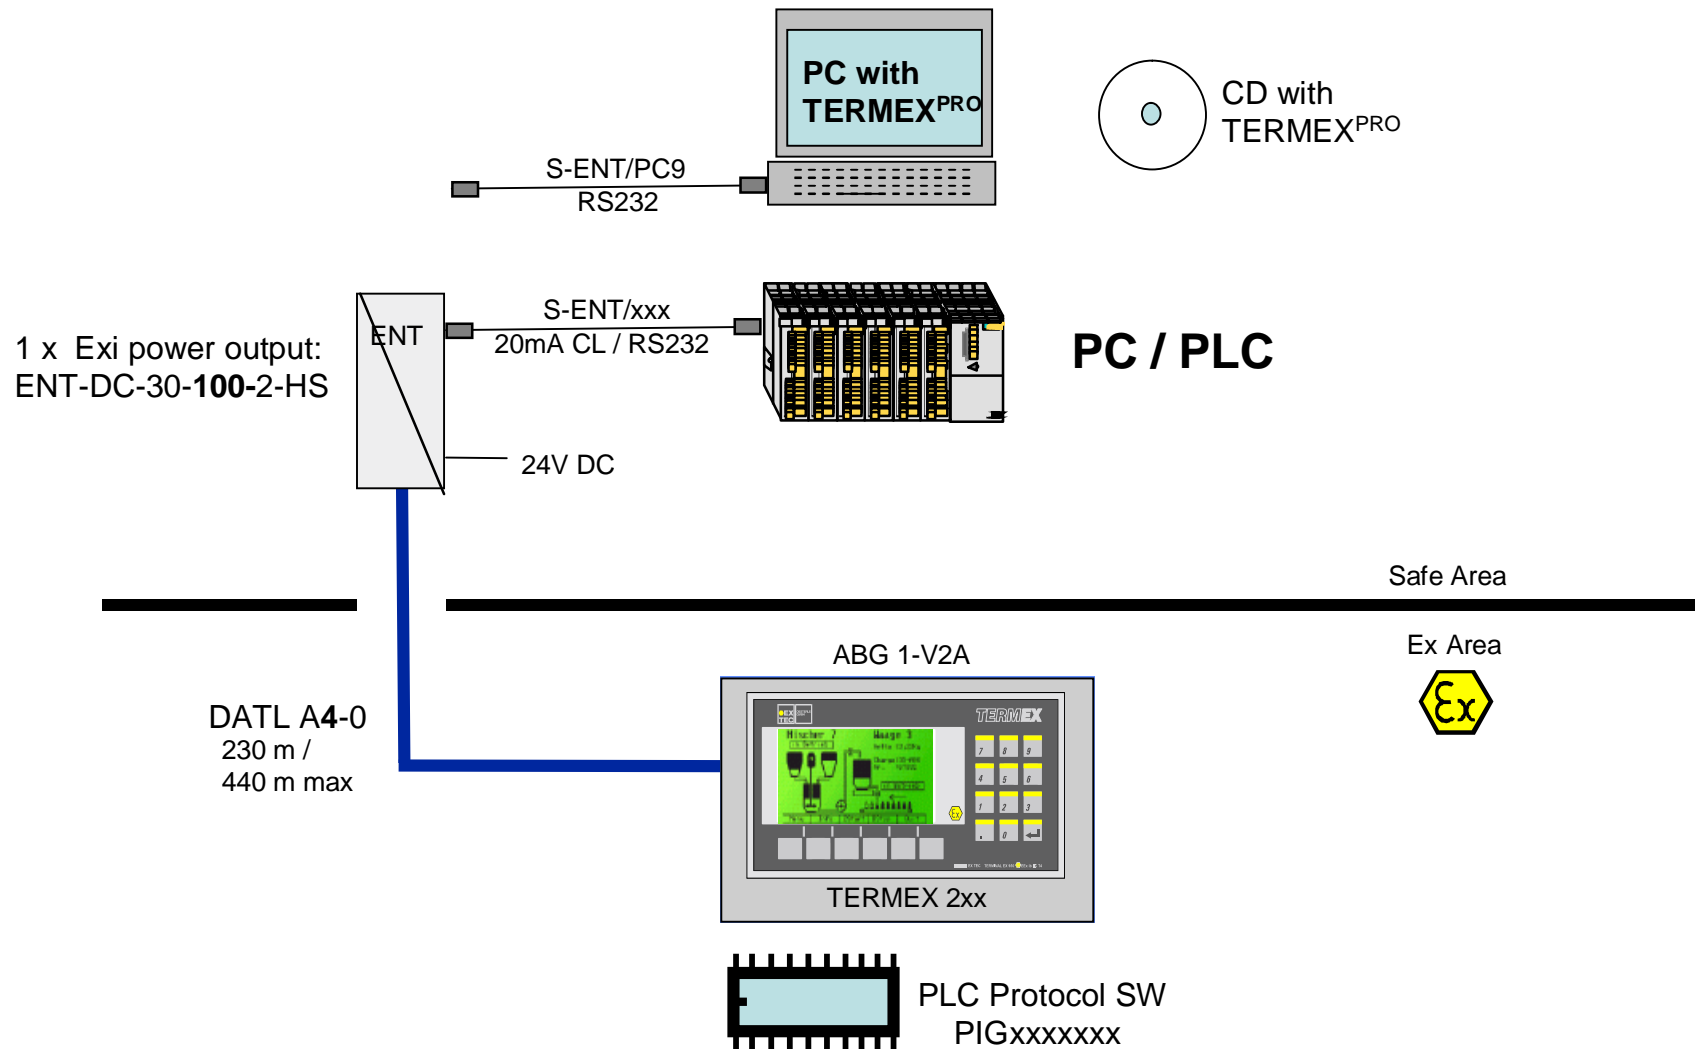


# Exi - Terminal TERMEX 220/230/320/330 S

Ex- Zone 1 and 2

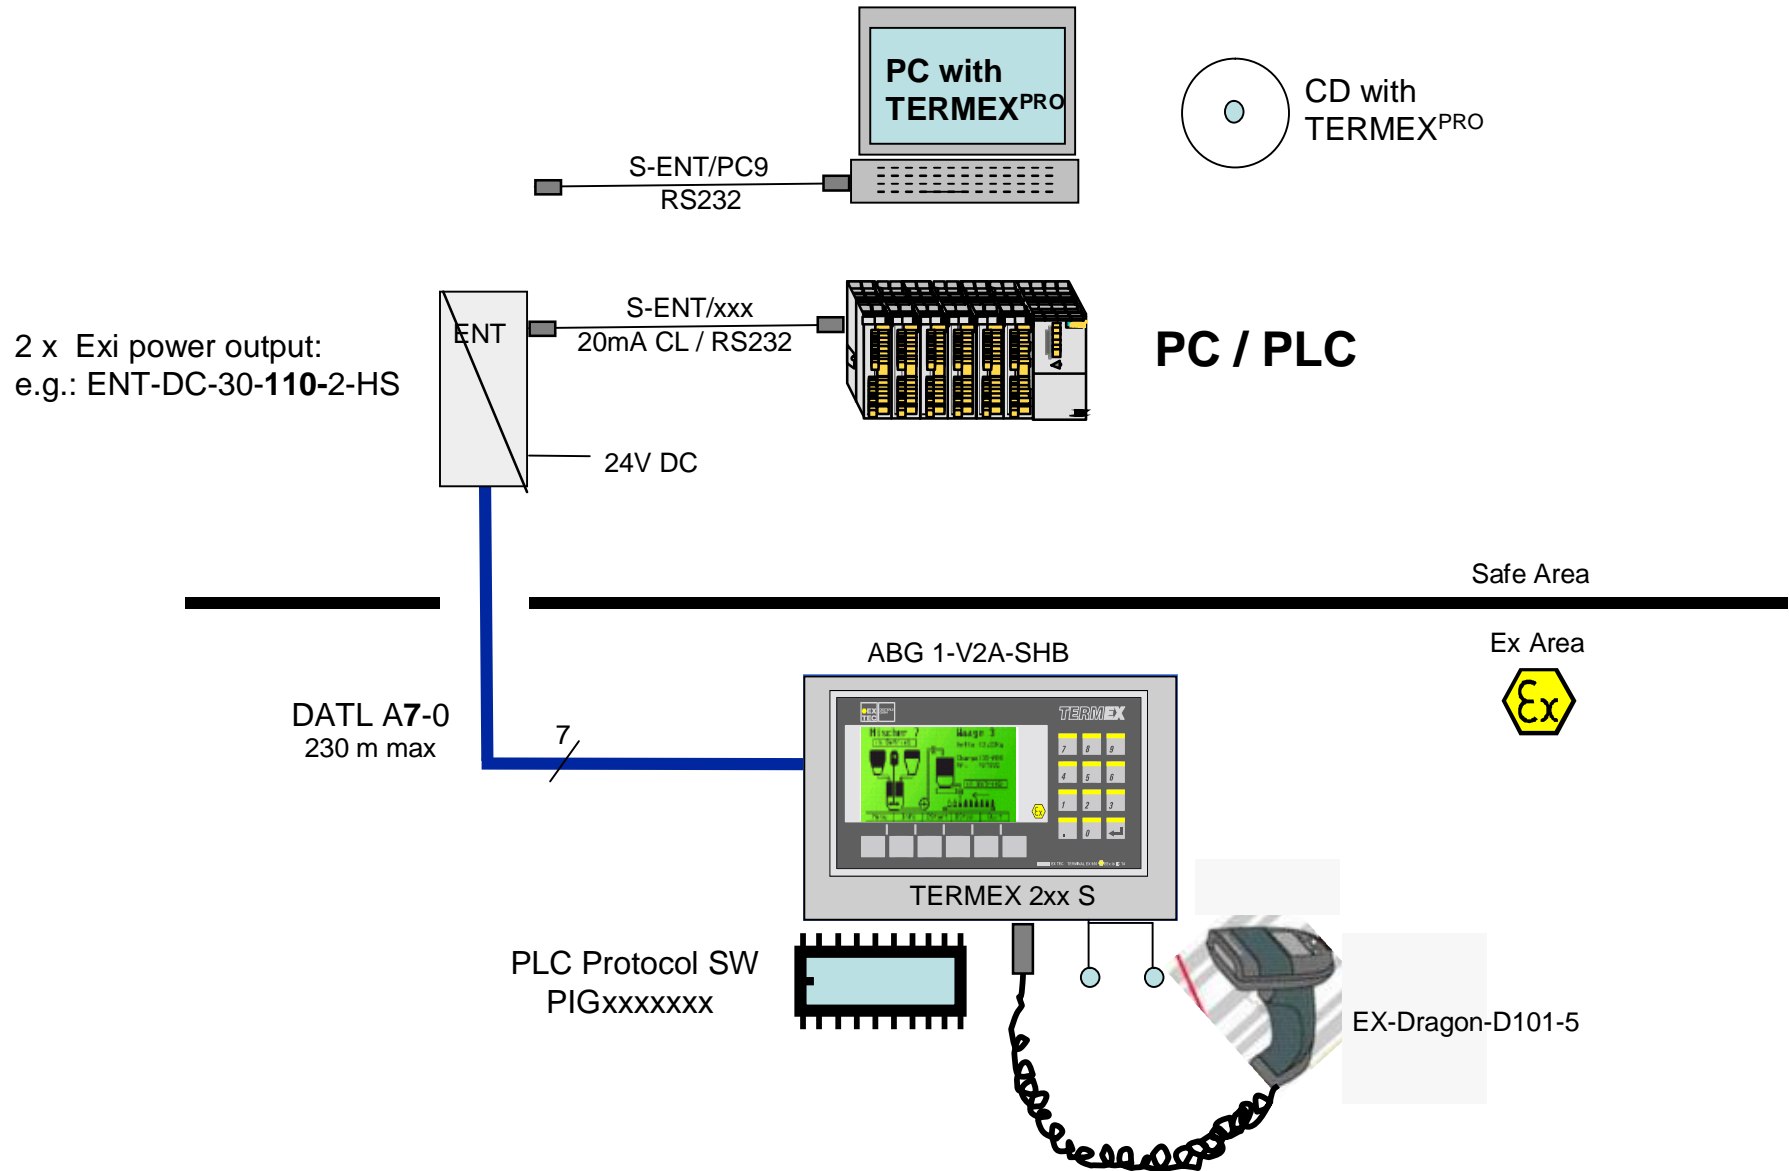


# Exi -Terminal TERMEX 220/230/320/330 WMa S

Ex- Zone 1 and 2

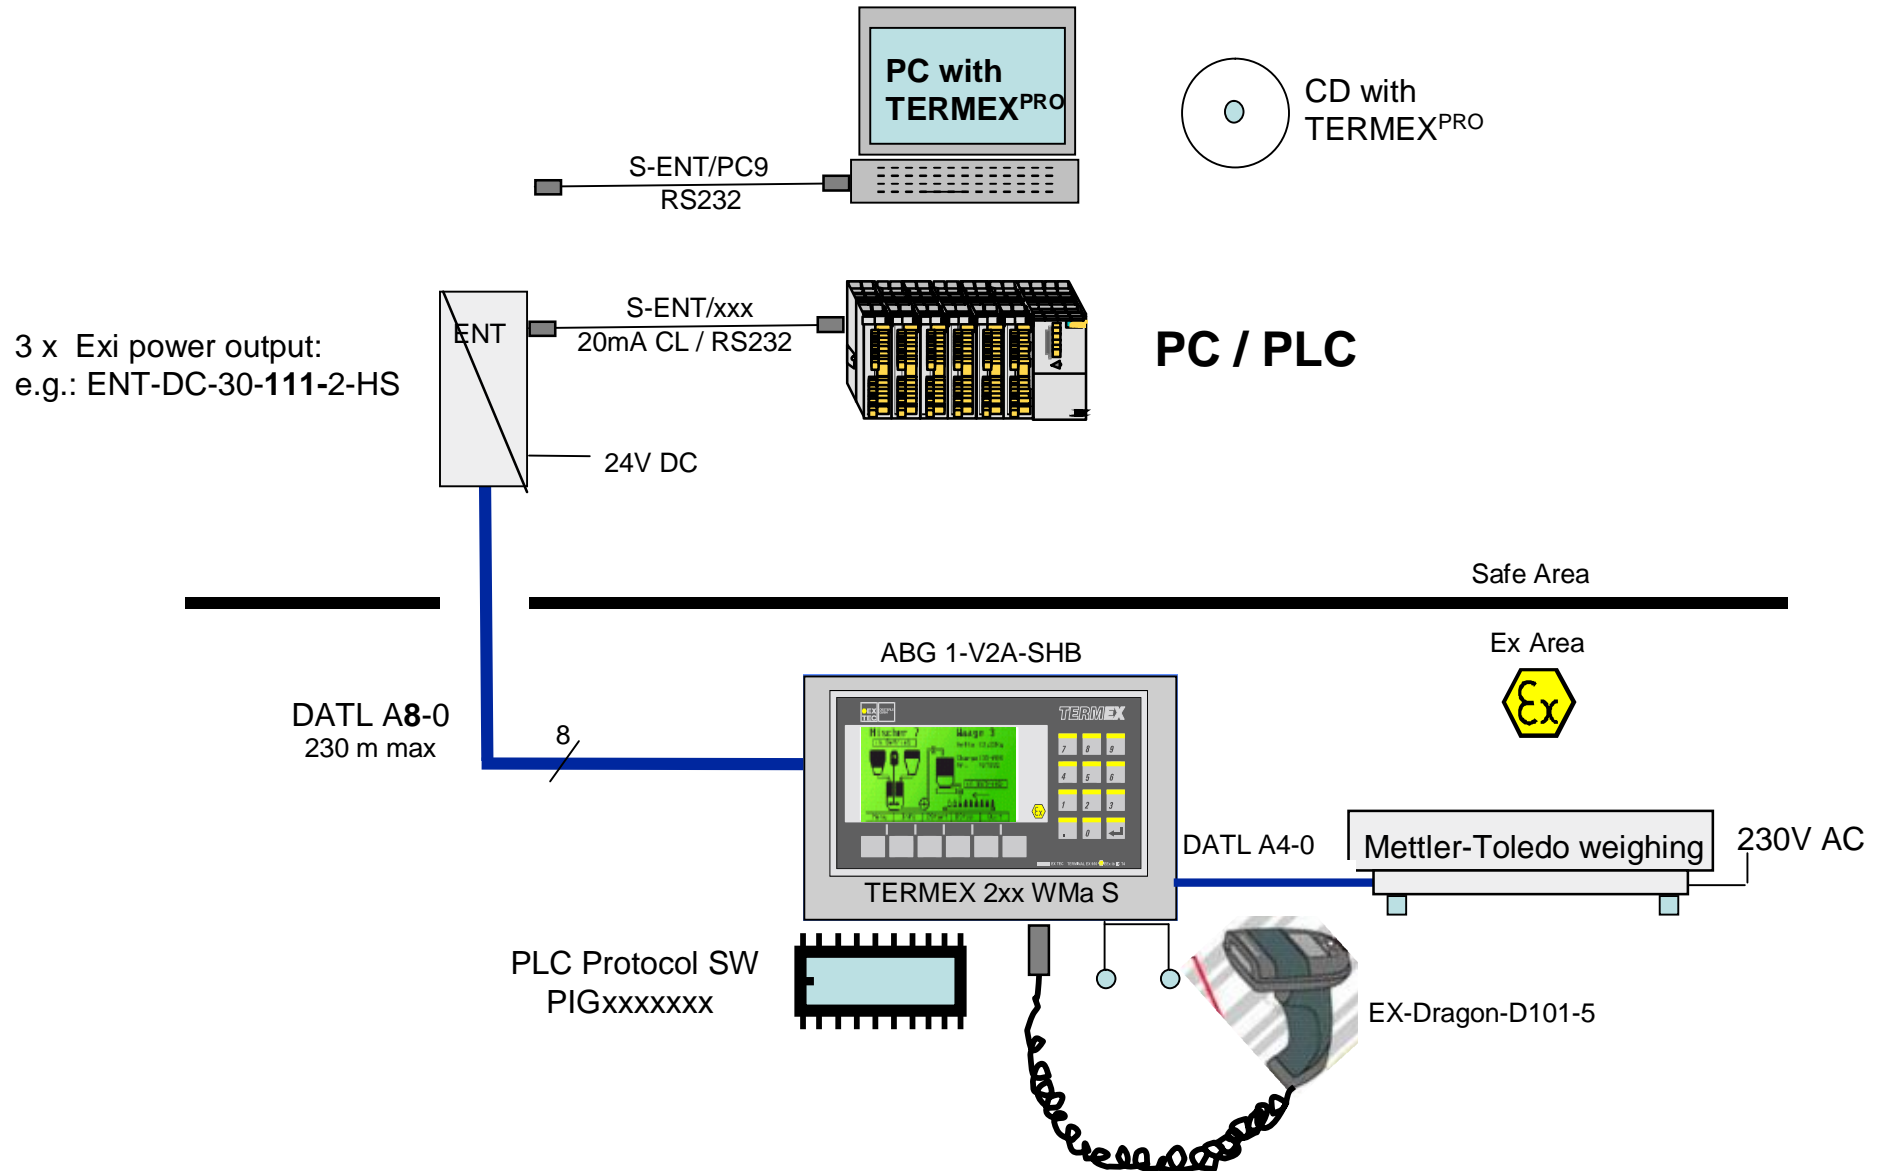


# Exi-Terminal TERMEX 220/230/320/330 W Sar S D

Ex- Zone 1 and 2

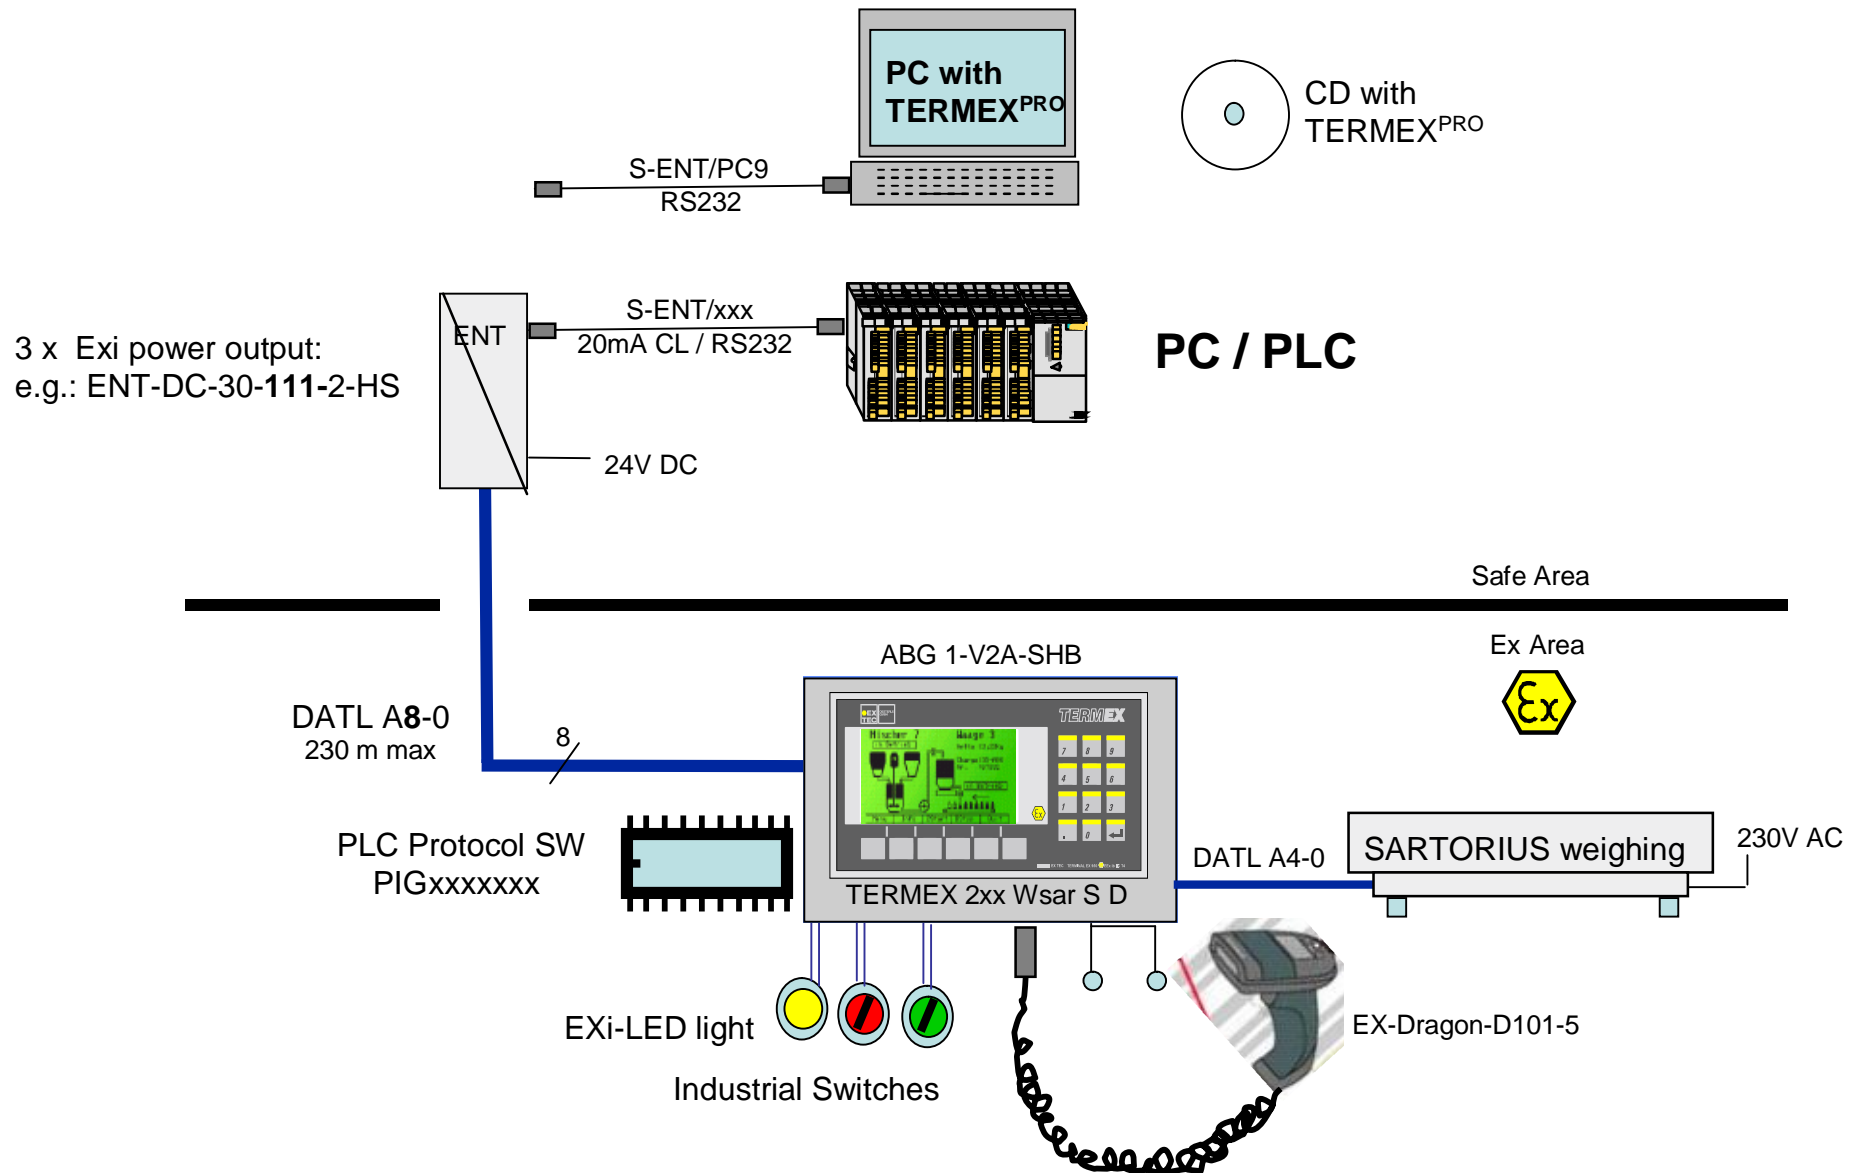


# Exi -Terminal TERMEX 220/230/320/330 MODBUS/RTU

Ex- Zone 1 and 2

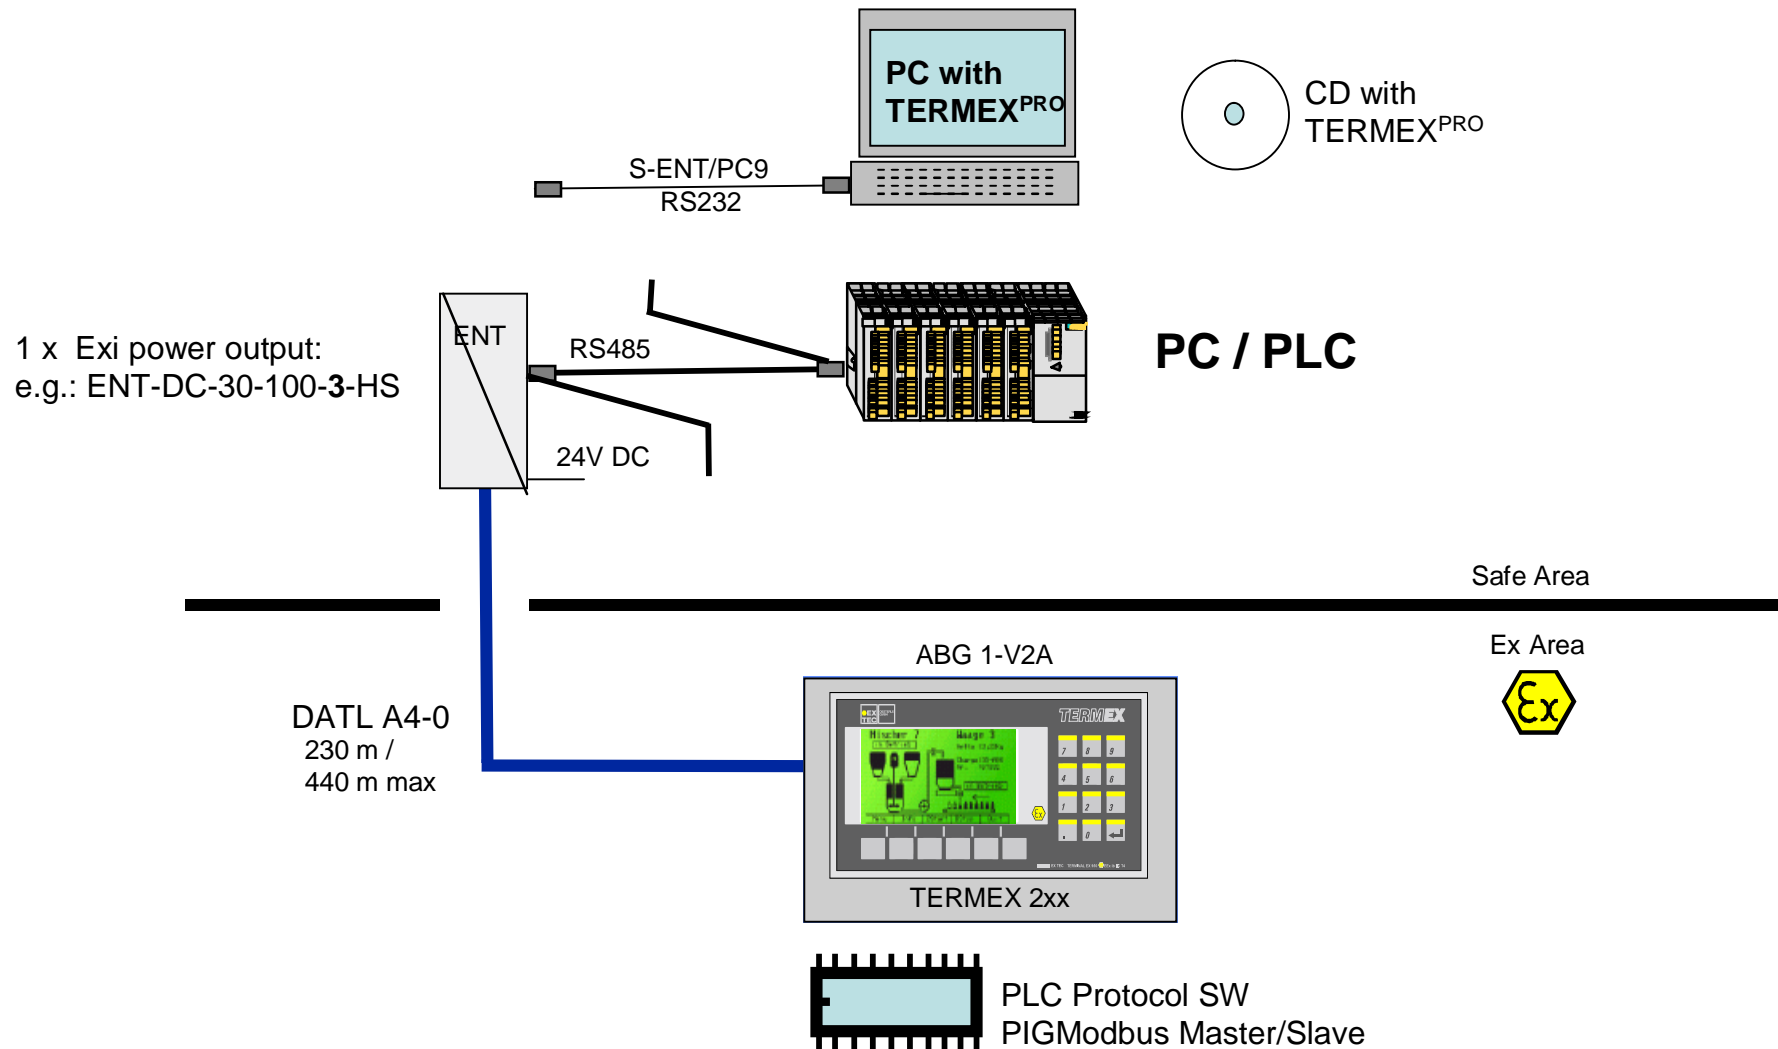


# Exi -Terminal TERMEX 220/230/320/330 S MODBUS/RTU

Ex- Zone 1 and 2

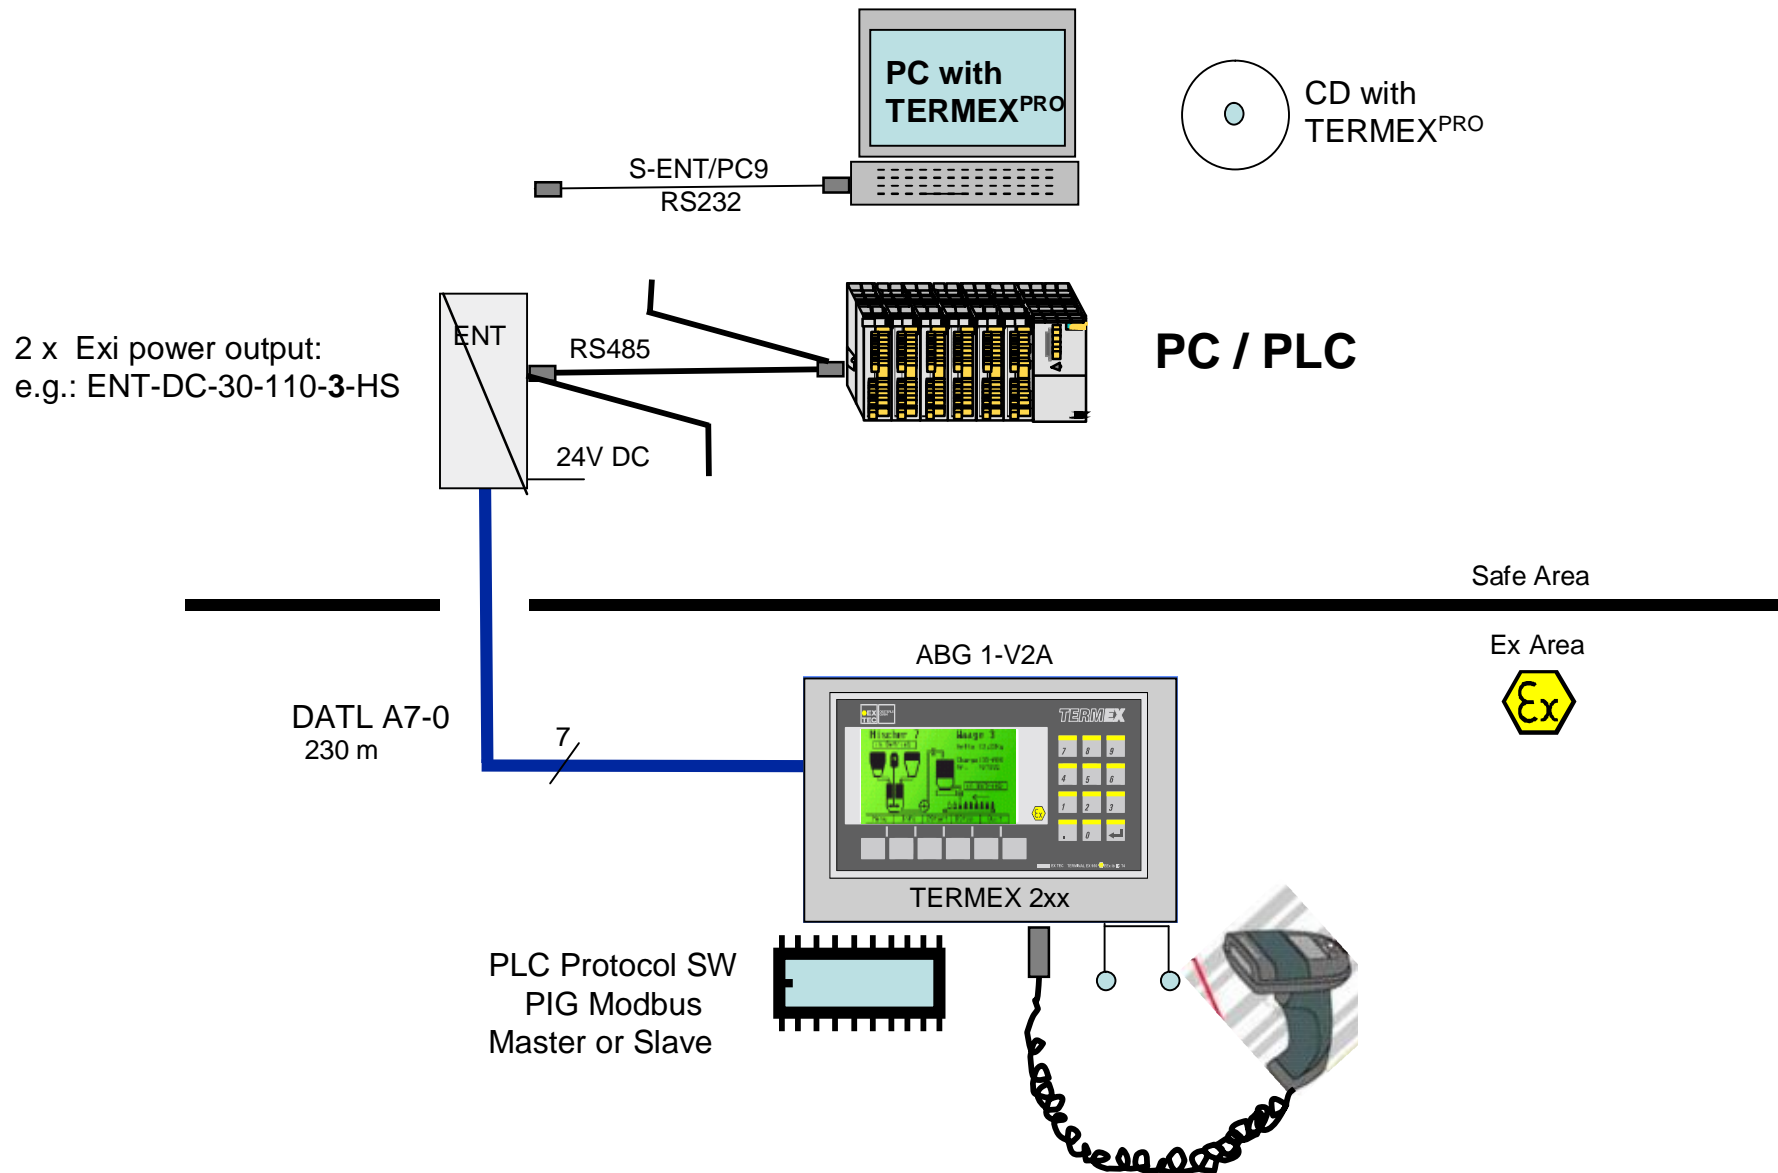

# Exi -Terminal TERMEX 220/230/320/330 SIEMENS S7 MPI

Ex- Zone 1 and 2

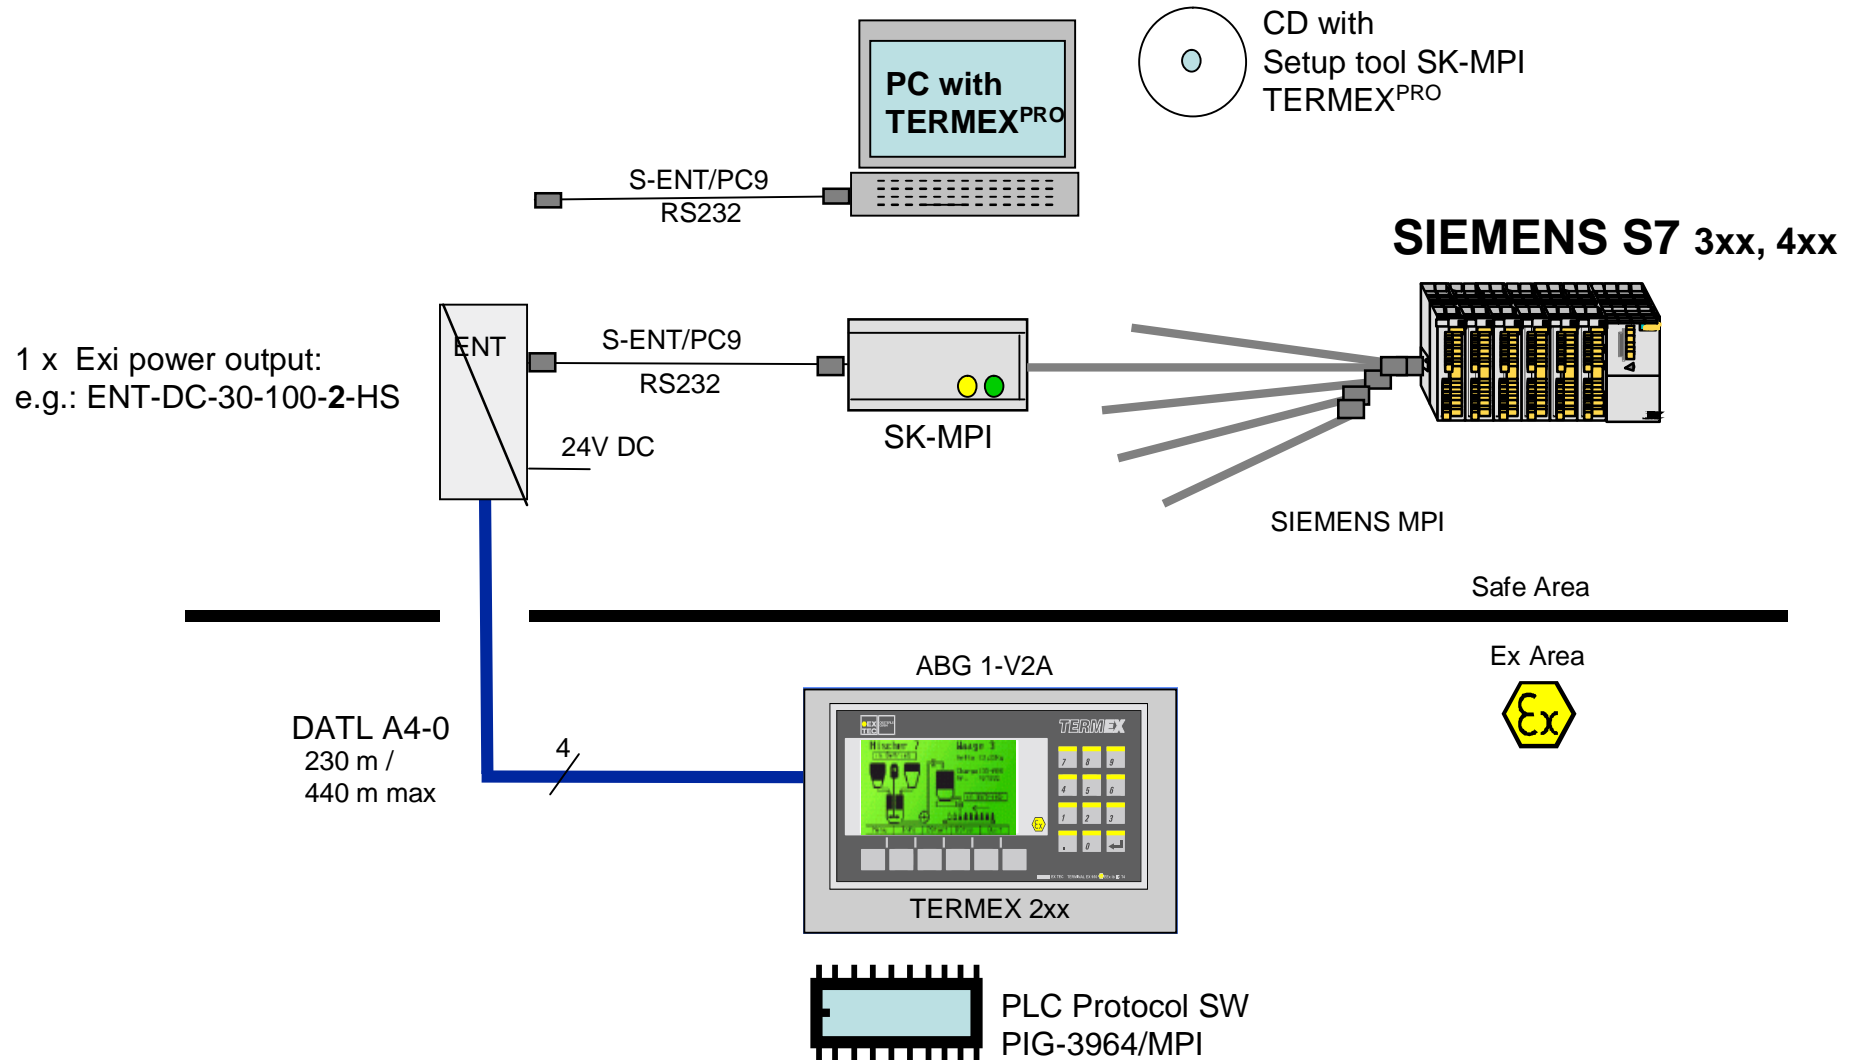

# Exi -Terminal TERMEX 220/230/320/330 Profibus-DP

Ex- Zone 1 and 2

